
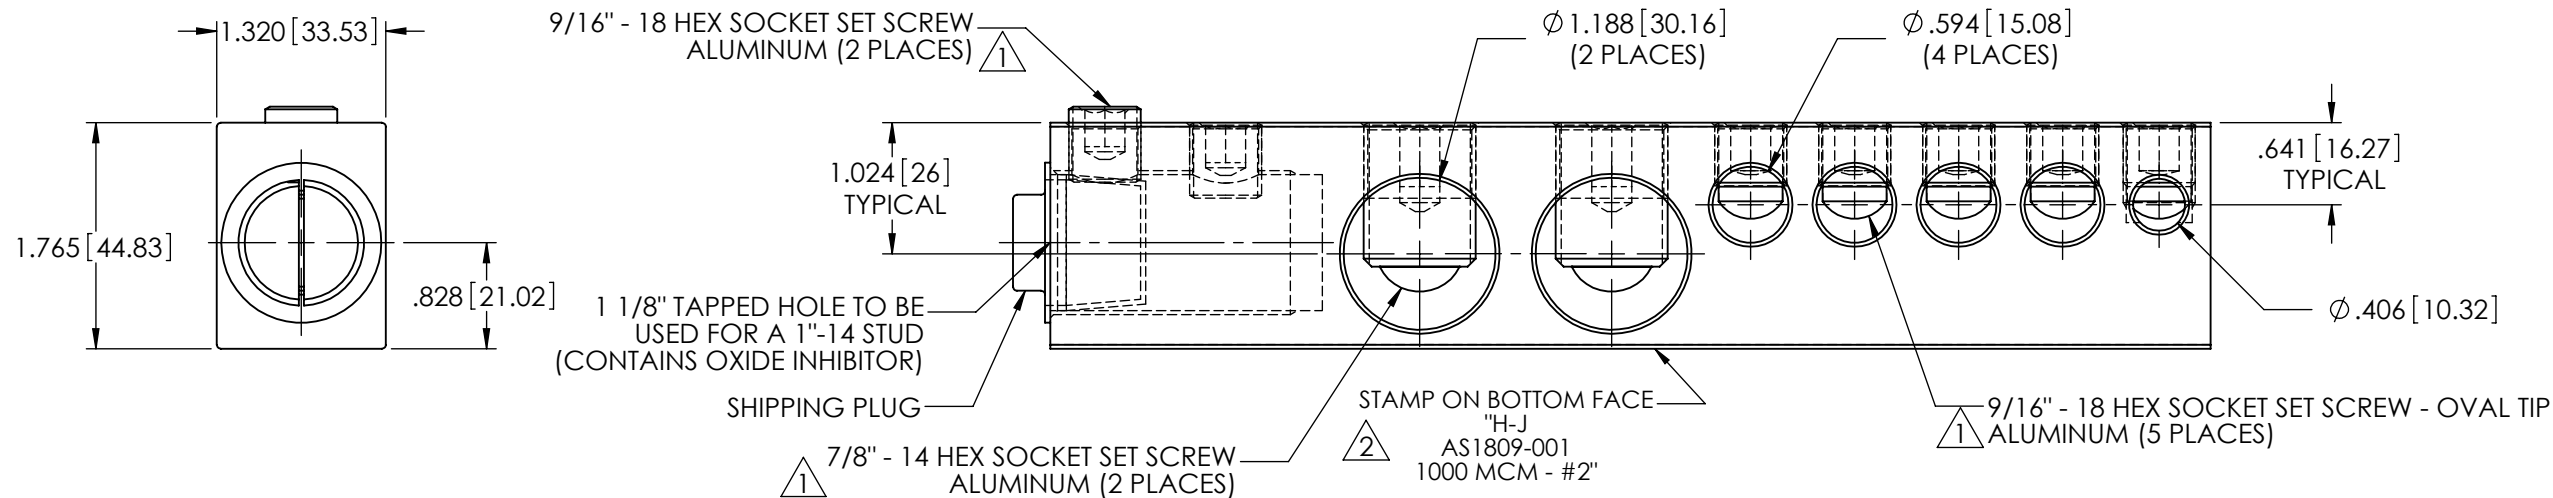
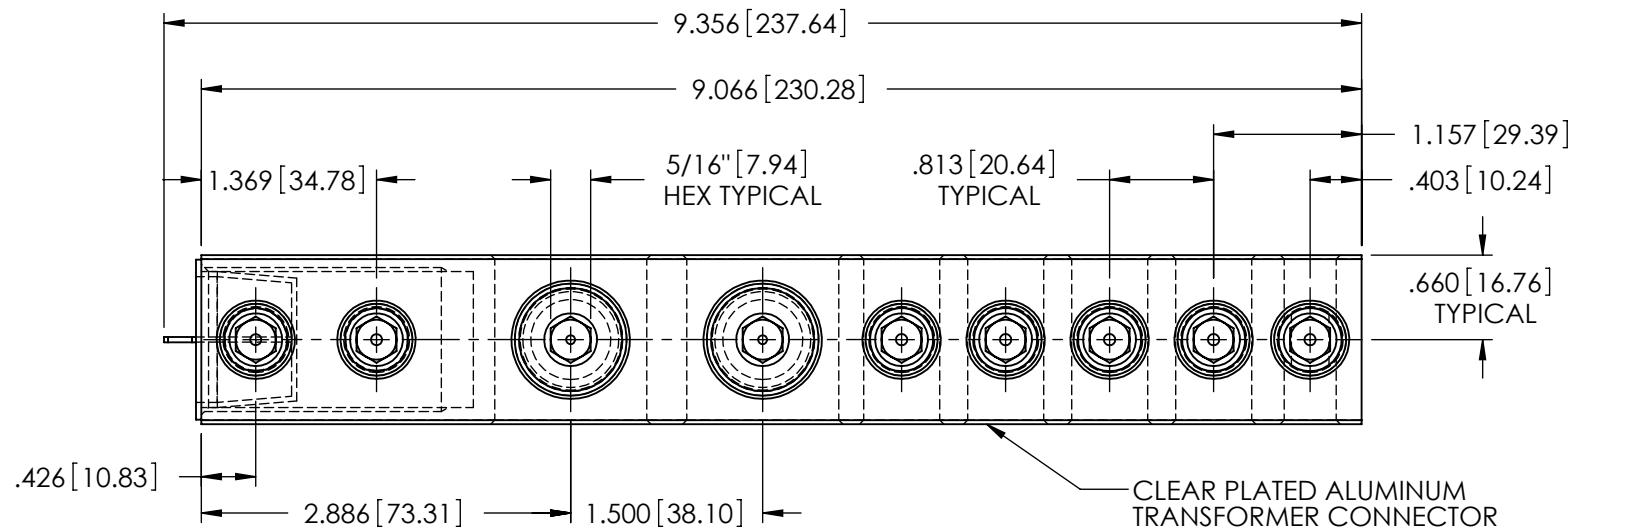


REVISIONS					
REV.	DATE	ECN #	DESCRIPTION	BY	APPROVED
1	12/19/2012	PQI# 11212002	REMOVED "ANODIZED" FROM SET SCREWS, WAS PRELIMINARY ASXXXX-099	CLS	PM
2	4/18/2013	HJ13-078	ADDED STAMP CALLOUT	CLS	AB

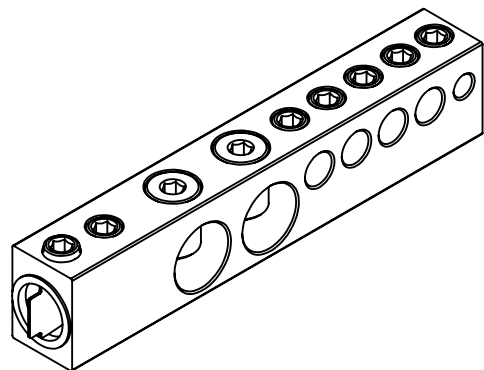

- NOTES:
1. ALL DIMENSIONS ARE REFERENCE ONLY UNLESS OTHERWISE SPECIFIED.
 2. CONDUCTOR RANGE: 1000 MCM - #2
 3. MEETS ANSI C119.4 CLASS A SPECIFICATIONS.

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF H-J ENTERPRISES, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF H-J ENTERPRISES, INC. IS PROHIBITED.

TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	
+/-	
FRACTIONAL	
+/-	
ANGULAR	
+/-	



DRAWN BY JH

DATE

10/20/2009

SCALE

N.T.S.

H-J ENTERPRISES, INC.
3010 HIGH RIDGE BLVD. HIGH RIDGE, MO. 63049 USA
PHONE 1-636-677-3421 FAX 1-636-376-1915

TRANSFORMER CONNECTOR ASSEMBLY

MATERIAL (SEE DRAWING)

CHK'D CJT

APP'D 04/18/13

DRAWING NO.

AS1809-001