

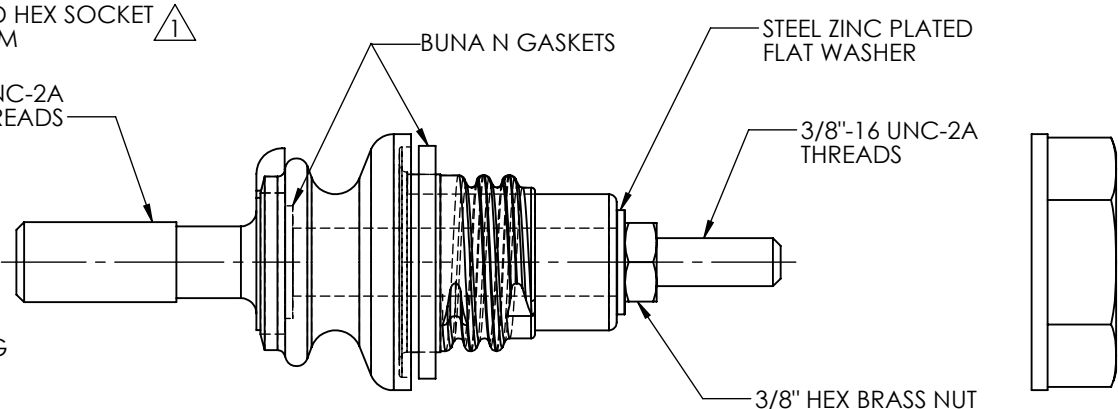


TRANSFORMER CONNECTOR ASSEMBLY  
AS1797-003  
QUANTITY-1

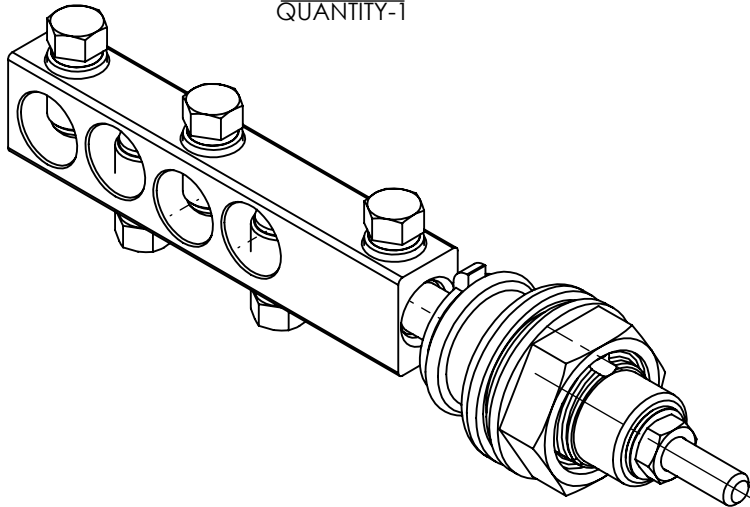

25 kVA L.V. BUSHING ASSEMBLY  
NON-PORCELAIN INSULATOR  
AS1801-001  
QUANTITY-1

MOUNTING NUT  
NT-0016-00  
QUANTITY-1

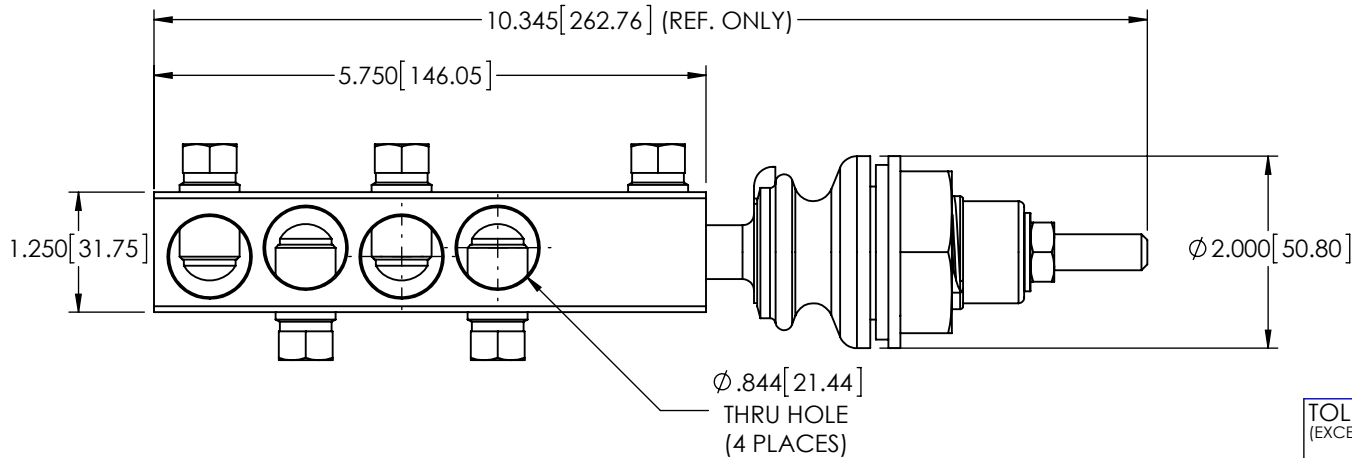

NOTES:  
1. REFER TO INDIVIDUAL DRAWINGS FOR DETAILED PART DIMENSIONS.  
2. EACH ITEM IS PACKED SEPARATELY IN BULK.

PROPRIETARY AND CONFIDENTIAL  
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF H-J ENTERPRISES, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF H-J ENTERPRISES, INC. IS PROHIBITED.

TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	
+/- .032"/.8mm	
FRACTIONAL	
+/-	
ANGULAR	
+/- 2 Degrees	



H - J ENTERPRISES, INC.  
3010 HIGH RIDGE BLVD. HIGH RIDGE, MO. 63049 USA  
PHONE 1-636-677-3421 FAX 1-636-376-1915

3 25 kVA L.V. BUSHING ASSEMBLY WITH A TRANSFORMER CONNECTOR FOR 350MCM

MATERIAL (SEE DRAWING)

CHK'D	CJT	APP'D	7/1/13
SCALE		N.T.S.	

DRAWING NO.  
KT0134-003

REVISIONS					
REV.	DATE	ECN #	DESCRIPTION	BY	APPROVED
1	11/12/2012	PQIE1111003	REMOVED ANODIZED FROM SCREWS.	CJT	PM
2	4/18/2013	HJ13-078	ADDED STAMP CALLOUT	CLS	AB
3	7/1/2013	HJ13-158	25 kVA WAS 25 KV.	BS	BB

DRAWN BY  
BS

DATE  
10/19/2012